

Evidence of performance
Airborne sound insulation of building components

Test Report

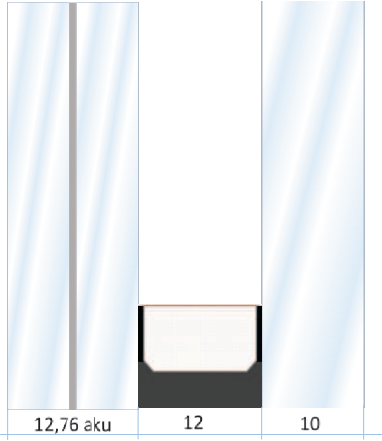
No. GLA-1301.4/17 E

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	12,76Aku/12/10
Designation:	66.2 Phon kl.P2A/12/TH1,1 10 Ar
Dimension:	1230 mm x 1480 mm
Gas filing:	Argon
Area related mass	57 kg/m ²
Cross-section:	

Rating	R _w (C; C _{tr})	STC	OITC
Basis	EN ISO 10140-1:2010 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	43 (-1; -5) dB	43 dB	35 dB

Łozienica, 25.01.2017


PhD Krzysztof Mech
Head of Acoustics Laboratory