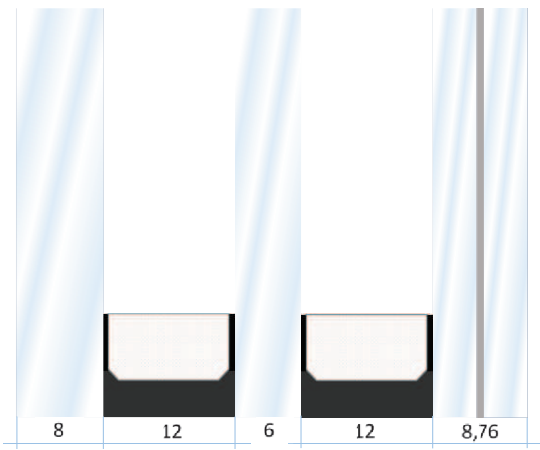


**Evidence of performance**  
**Airborne sound insulation of building components**

Test Report

No. GLA-1301.3/17 E

Client**PRESS GLASS S.A.**Nowa Wieś  
ul. Kopalniana 9  
42-262 Poczesna

Product:	Insulating glass unit
Construction:	8/12/6/12/8,76
Designation:	TH1,1 8/12/FL 6/12/44.2 TH1,1 kl.P2A Ar
Dimension:	1230 mm x 1480 mm
Gas filling:	Argon
Area related mass	57 kg/m <sup>2</sup>
Cross-section:	

Rating	R <sub>w</sub> (C; C <sub>tr</sub> )	STC	OITC
Basis	EN ISO 10140-1:2010 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	<b>43 (-3; -8) dB</b>	<b>43 dB</b>	<b>32 dB</b>

Łozienica, 24.01.2017

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory