

**Evidence of performance**  
**Airborne sound insulation of building components**

Test Report

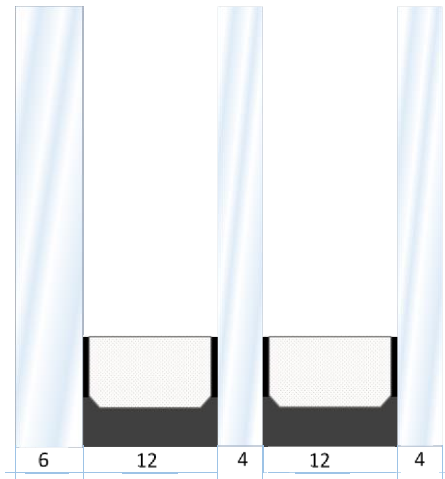
No. GLA-1288.4/16

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	6 / 12 / 4 / 12 / 4
Designation:	TH1,1 6/12/FL 4/12/TH1,1 4 Ar
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	$R_w$ (C; C <sub>tr</sub> )	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	<b>36 (-2; -6) dB</b>	<b>36 dB</b>	<b>27 dB</b>

Łozienica, 23.11.2016

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory