

Evidence of performance
Airborne sound insulation of building components

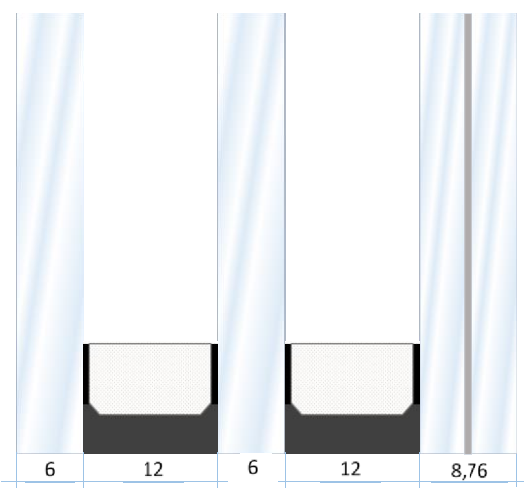
Test Report

No. GLA-1288.3/16Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	6 / 12 / 6 / 12 / 8,76
Designation:	TH1,1 6/12/FL 6/12/44.2 TH1,1 class P2A Ar
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	R_w (C; C _{tr})	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	40 (-2; -7) dB	40 dB	30 dB

Łozienica, 25.10.2016


PhD Krzysztof Mech
Head of Acoustics Laboratory