

**Evidence of performance**  
**Airborne sound insulation of building components**

Test Report

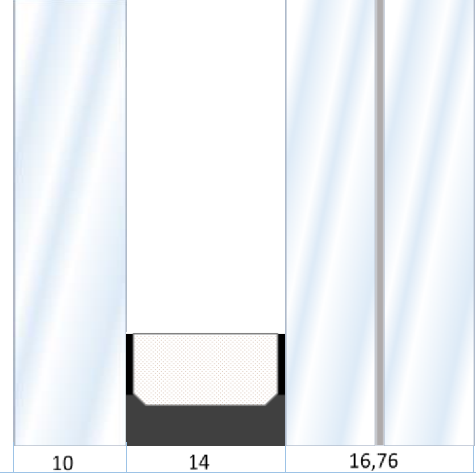
No. GLA-1288.11/16

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	10/14/16,76
Designation:	<i>FL 10/14/VSG (TH1,1 8/0,76 PVB/FL 8) kl.1/B/1 Ar</i>
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	$R_w$ (C; C <sub>tr</sub> )	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	<b>43 (-2; -4) dB</b>	<b>43 dB</b>	<b>37dB</b>

Łozienica, 8.12..2016

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory