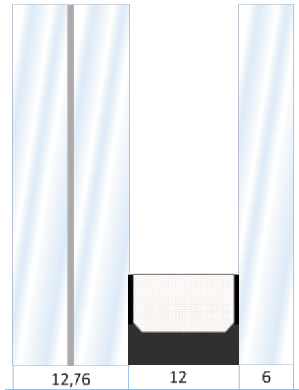


**Evidence of performance
Airborne sound insulation of building components**

Test Report

No. GLA-1312.8/17 E

Client**PRESS GLASS S.A.**Nowa Wieś
ul. Kopalniana 9
42-262 Poczesna

Product:	Insulating glass unit
Construction:	12,76 / 12/ 6
Designation:	66.2 kl.P2A/12/TH1,1 6 U=1,3 EN673 Ar
Dimension:	1230 mm x 1480 mm
Gas filing:	Argon
Area related mass	47 kg/m ²
Cross-section:	

Rating	R _w (C; C _{tr})	STC	OITC
Basis	EN ISO 10140-1:2010 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	40 (-1; -5)dB	40 dB	33 dB

Łozienica, 17.05.2017

PhD Krzysztof Mech
Head of Acoustics Laboratory