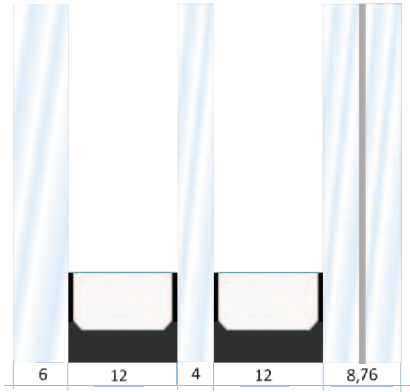


Evidence of performance
Airborne sound insulation of building components

Test Report

No. GLA-1312.2/17 E

Client**PRESS GLASS S.A.**Nowa Wieś
ul. Kopalniana 9
42-262 Poczesna

Product:	Insulating glass unit
Construction:	6/12/4/12/8,76
Designation:	TH1,1 6/12/FL 4/12/44.2 TH1,1 kl.P2A U=0,7 EN673 Ar
Dimension:	1230 mm x 1480 mm
Gas filing:	Argon
Area related mass	47 kg/m ²
Cross-section:	

Rating	R _w (C; C _{tr})	STC	OITC
Basis	EN ISO 10140-1:2010 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	41 (-3; -8) dB	41 dB	29 dB

Łozienica, 06.04.2017


PhD Krzysztof Mech
Head of Acoustics Laboratory