

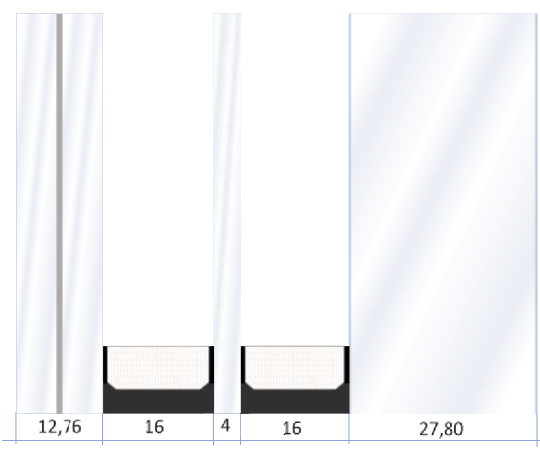
Evidence of performance Airborne sound insulation of building components

Based on the Test Report: **No. GLA-1331.3/17 E**

Client

PRESS GLASS S.A.

Nowa Wieś
ul. Kopalniana 9
42-262 Poczesna

Product:	Insulating glass unit
Construction:	12,76/16/4/16/27,8
Designation:	66.2 TH 1,1 kl.P2A /16/FL 4/16/VSG (27,80 kl.P8B) TH1,1 kl.1/B/1 Ar
Dimension:	1230 mm x 1480 mm
Gas filling:	Argon
Area related mass	106 kg/m ²
Cross-section:	

Rating	R _w (C; C _{tr})	STC	OITC
Basis	EN ISO 10140-1:2016 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-16	ASTM E1332-16
Value	48 (-1; -3) dB	48 dB	37 dB

Łozienica, 02.08.2017

PhD Krzysztof Mech
Head of Acoustics Laboratory