

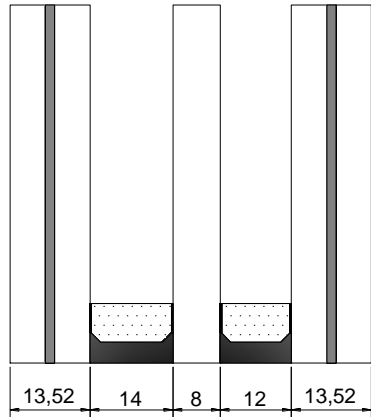
Evidence of performance Airborne sound insulation of building components

Based on the Test Report: **No. GLA-1378.1/18 E**

Client

PRESS GLASS S.A.

Nowa Wieś
ul. Kopalniana 9
42-262 Poczesna

Product:	Insulating glass unit
Construction:	13,52acoust./14/8/12/13,52acoust.
Designation:	VSG (FL 6 tough./1,52 PVB acoustic/TH1,0 6 tough.) kl.1/B/1/ 14 / FL8 tough. / 12 /VSG (TH1,0 6 tough./1,52 PVB acoustic/FL 6 tough.)kl.1/B/1 U=0,6 EN673 Ar
Dimension:	1230 mm x 1480 mm
Gas filing:	Argon
Area related mass	80,5 kg/m ²
Cross-section:	

Rating	R _w (C; C _{tr})	STC	OITC
Basis	EN ISO 10140-1:2016 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-16	ASTM E1332-16
Value	51 (-1; -4)dB	51 dB	42 dB

Łozienica, 30.05.2018

PhD Krzysztof Mech
Head of Acoustics Laboratory