

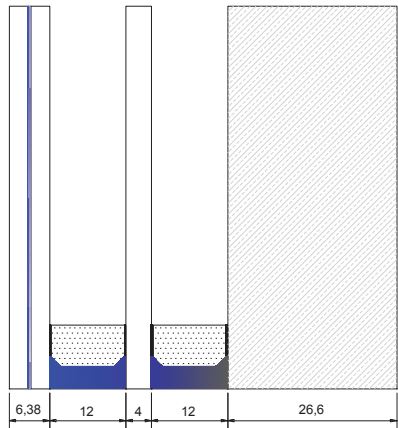
Evidence of performance Airborne sound insulation of building components

Based on the Test Report: No. GLA-1414 / 18 E

Client

PRESS GLASS S.A.

Nowa Wieś
ul. Kopalniana 9
42-262 Poczesna

Product:	Insulating glass unit
Construction:	6,38/12/4/12/26,60.
Designation:	33.1 kl.2(B)2/12/FL 4/12/Pyrobel 25 wewnętrzny kl.EI60 Ar
Dimension:	1230 mm x 1480 mm
Gas filing:	Argon
Area related mass	89,5 kg/m ²
Cross-section:	

Rating	R _w (C; C _{tr})	STC	OITC
Basis	EN ISO 10140-1:2016 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-16	ASTM E1332-16
Value	46 (-2; -6)dB	46 dB	36 dB

Łozienica, 08.11.2018

dr Krzysztof Mech
Kierownik Laboratorium Akustyki